



**SECTION - ELEVATION**  
NTS

- NOTES: DESIGN PER AWMA D-1110
- MATERIALS:
    - CONCRETE: ACI 301; 3500 PSI
    - SHOTCRETE: ACI 506; 4000PSI
    - REINFORCING: ASTM A615; GRADE 40 MIN.
    - DIAPHRAGM: ASTM A-366; 26 GAUGE
    - PRESTRESSING: ASTM A-821; 6 GAUGE
  - ACCESSORIES
    - DOME VENT
    - ACCESS HATCH
    - OUTSIDE ALUMINUM LADDER
    - INSIDE FIBERGLASS LADDER
    - HANDRAIL AROUND DOME HATCH
    - WALL MANHOLE
    - DOME CONCRETE OVERFLOWS
    - LIQUID LEVEL INDICATOR
    - PIPE VORTEX BREAKER
  - PAINT EXPOSED EXTERIOR
    - PRIME COAT THOROSEAL
    - FINISH 2 COATS PORTER 519 ACRYLIC
  - MATERIALS TESTING
    - 3 CYLINDERS; 1 AT 7 DAYS, 1 AT 28 DAYS, 1 HOLD FLOOR
    - DOME - 1 SET
    - OUTSIDE WALL - 2 SETS
    - INSIDE WALL - 1 SET

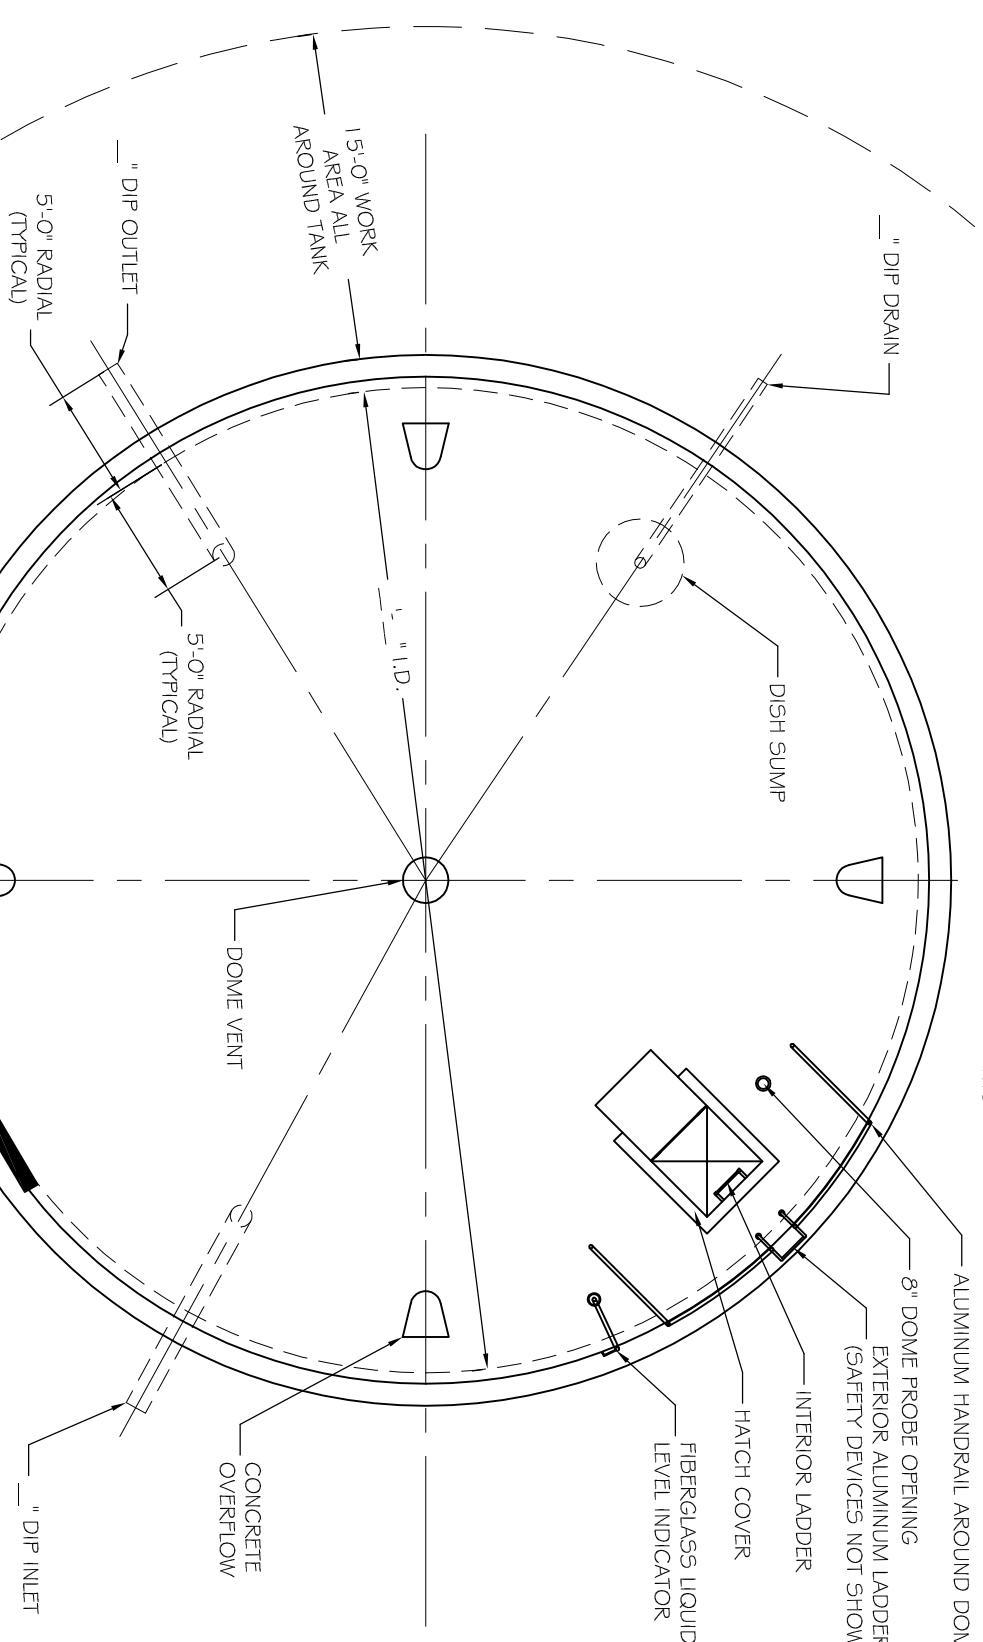

**PLAN**  
NTS

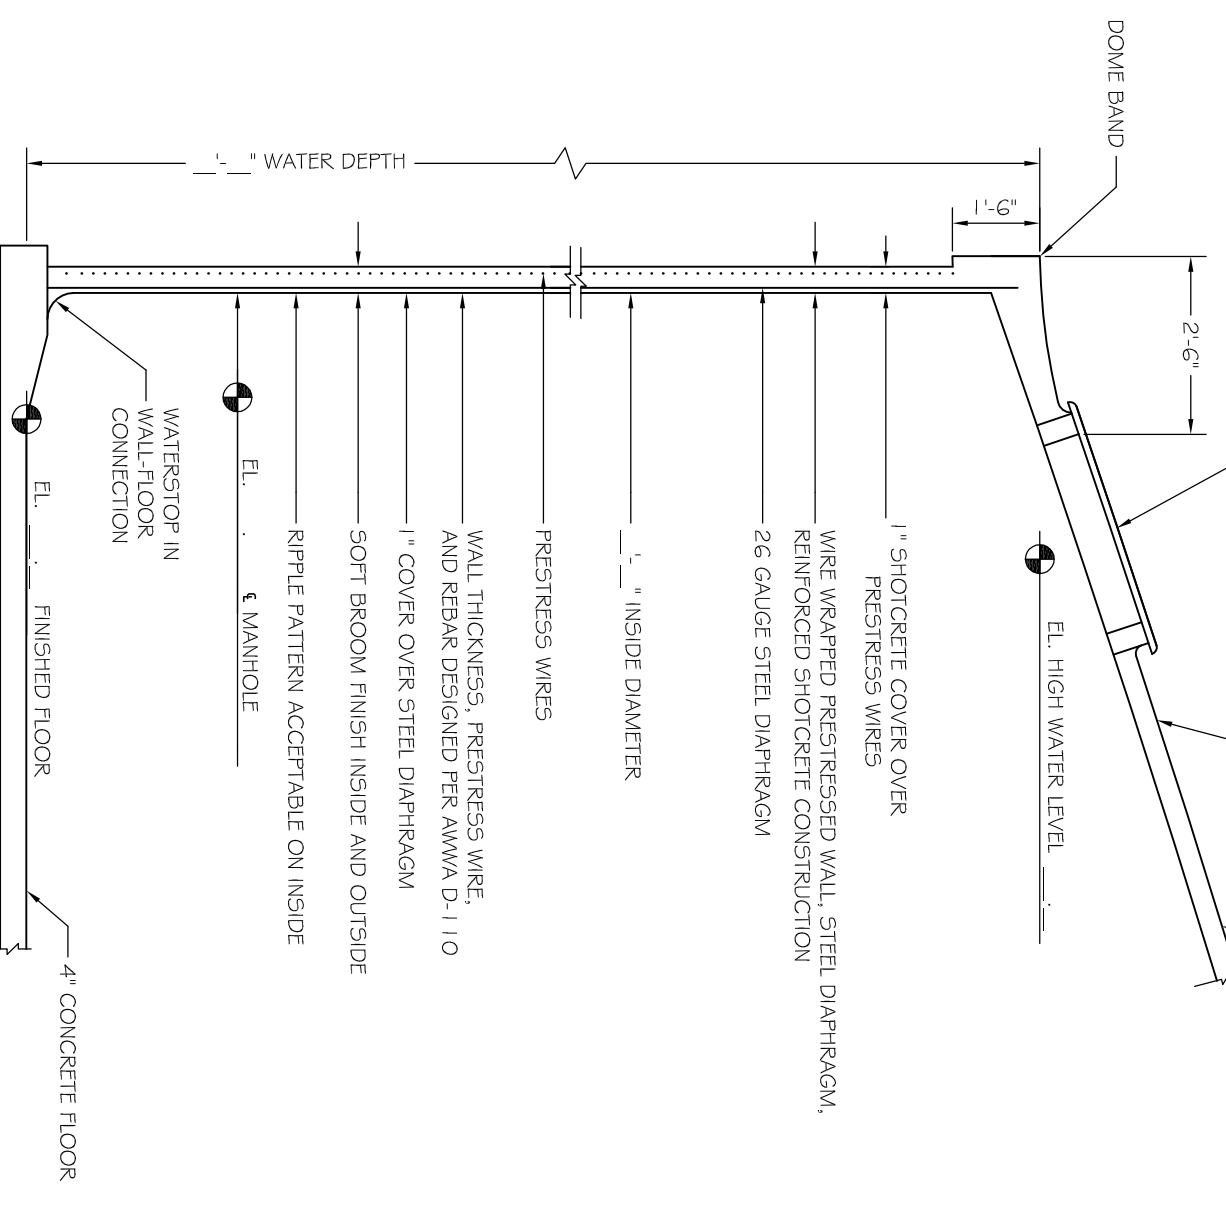

**TANK SECTION**  
NTS

FIELD VERIFY ALL PIPE AND ACCESSORY LOCATIONS

**PRECORP CORPORATION**  
115 SW 140th TERRACE  
MEMBERRY, FL 32869  
(352) 332-1200  
(FAX) 332-1199

**PRECORP**  
PRESTRESSED CONCRETE TANKS

AUTOCAD FILENAME:  
Tank Plan & Section View (webpage)

Drawn: JAG  
Check: ---  
Appvd. ---  
Date: --/--

Job No. ---  
Sht. ---  
of 01